



NSAI
Standards

Irish Standard
I.S. EN 62689-2:2017

Current and voltage sensors or detectors, to be used for fault passage indication purposes - Part 2: System aspects

I.S. EN 62689-2:2017

Incorporating amendments/corrigenda/National Annexes issued since publication:

The National Standards Authority of Ireland (NSAI) produces the following categories of formal documents:

I.S. xxx: Irish Standard — national specification based on the consensus of an expert panel and subject to public consultation.

S.R. xxx: Standard Recommendation — recommendation based on the consensus of an expert panel and subject to public consultation.

SWiFT xxx: A rapidly developed recommendatory document based on the consensus of the participants of an NSAI workshop.

This document replaces/revises/consolidates the NSAI adoption of the document(s) indicated on the CEN/CENELEC cover/Foreword and the following National document(s):

NOTE: The date of any NSAI previous adoption may not match the date of its original CEN/CENELEC document.

This document is based on:

EN 62689-2:2017

Published:

2017-09-22

This document was published under the authority of the NSAI and comes into effect on:

2017-10-10

ICS number:

17.220.20

NOTE: If blank see CEN/CENELEC cover page

NSAI
1 Swift Square,
Northwood, Santry
Dublin 9

T +353 1 807 3800
F +353 1 807 3838
E standards@nsai.ie
W NSAI.ie

Sales:
T +353 1 857 6730
F +353 1 857 6729
W standards.ie

Údarás um Chaighdeáin Náisiúnta na hÉireann

National Foreword

I.S. EN 62689-2:2017 is the adopted Irish version of the European Document EN 62689-2:2017, Current and voltage sensors or detectors, to be used for fault passage indication purposes - Part 2: System aspects

This document does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

For relationships with other publications refer to the NSAI web store.

Compliance with this document does not of itself confer immunity from legal obligations.

In line with international standards practice the decimal point is shown as a comma (,) throughout this document.

This page is intentionally left blank

EUROPEAN STANDARD

EN 62689-2

NORME EUROPÉENNE

EUROPÄISCHE NORM

September 2017

ICS 17.220.20

English Version

**Current and voltage sensors or detectors, to be used for fault
passage indication purposes - Part 2: System aspects
(IEC 62689-2:2016)**

Capteurs ou détecteurs de courant et de tension, à utiliser
pour indiquer le passage d'un courant de défaut -
Partie 2: Aspects systèmes
(IEC 62689-2:2016)

Strom- und Spannungs-Sensoren oder Anzeigeegeräte zur
Erkennung von Kurz- und Erdschlüssen -
Teil 2: Systemaspekte
(IEC 62689-2:2016)

This European Standard was approved by CENELEC on 2017-06-17. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.



European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique
Europäisches Komitee für Elektrotechnische Normung

CEN-CENELEC Management Centre: Avenue Marnix 17, B-1000 Brussels

EN 62689-2:2017**European foreword**

The text of document 38/504/FDIS, future edition 1 of IEC 62689-2, prepared by IEC/TC 38 "Instrument transformers" was submitted to the IEC-CENELEC parallel vote and approved by CENELEC as EN 62689-2:2017.

The following dates are fixed:

- latest date by which the document has to be implemented at national level by publication of an identical national standard or by endorsement (dop) 2018-03-22
- latest date by which the national standards conflicting with the document have to be withdrawn (dow) 2020-09-22

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CENELEC shall not be held responsible for identifying any or all such patent rights.

Endorsement notice

The text of the International Standard IEC 62689-2:2016 was approved by CENELEC as a European Standard without any modification.

In the official version, for Bibliography, the following notes have to be added for the standards indicated:

IEC 60044-7	NOTE	Harmonized as EN 60044-7.
IEC 60044-8	NOTE	Harmonized as EN 60044-8.
IEC 60721-3-4	NOTE	Harmonized as EN 60721-3-4.
IEC 60870-5-101	NOTE	Harmonized as EN 60870-5-101.
IEC 60870-5-104	NOTE	Harmonized as EN 60870-5-104.
IEC 61850-7-2	NOTE	Harmonized as EN 61850-7-2.
IEC 61850-7-3	NOTE	Harmonized as EN 61850-7-3.
IEC 61869-1	NOTE	Harmonized as EN 61869-1.
IEC 61869-4	NOTE	Harmonized as EN 61869-4.
IEC 61869-6	NOTE	Harmonized as EN 61869-6.

Annex ZA (normative)

Normative references to international publications with their corresponding European publications

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

NOTE 1 Where an International Publication has been modified by common modifications, indicated by (mod), the relevant EN/HD applies.

NOTE 2 Up-to-date information on the latest versions of the European Standards listed in this annex is available here: www.cenelec.eu.

<u>Publication</u>	<u>Year</u>	<u>Title</u>	<u>EN/HD</u>	<u>Year</u>
IEC 62689-1	-	Current and voltage sensors or detectors, to be used for fault passage indication purposes - Part 1: General principles and requirements	EN 62689-1	-

This page is intentionally left blank



IEC 62689-2

Edition 1.0 2016-05

INTERNATIONAL STANDARD

NORME INTERNATIONALE



**Current and voltage sensors or detectors, to be used for fault passage
indication purposes –
Part 2: System aspects**

**Capteurs ou détecteurs de courant et de tension, à utiliser pour indiquer
le passage d'un courant de défaut –
Partie 2: Aspects systèmes**



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2016 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de l'IEC ou du Comité national de l'IEC du pays du demandeur. Si vous avez des questions sur le copyright de l'IEC ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de l'IEC de votre pays de résidence.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
Fax: +41 22 919 03 00
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

IEC Catalogue - webstore.iec.ch/catalogue

The stand-alone application for consulting the entire bibliographical information on IEC International Standards, Technical Specifications, Technical Reports and other documents. Available for PC, Mac OS, Android Tablets and iPad.

IEC publications search - www.iec.ch/searchpub

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and also once a month by email.

Electropedia - www.electropedia.org

The world's leading online dictionary of electronic and electrical terms containing 20 000 terms and definitions in English and French, with equivalent terms in 15 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Glossary - std.iec.ch/glossary

65 000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: csc@iec.ch.

A propos de l'IEC

La Commission Electrotechnique Internationale (IEC) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

A propos des publications IEC

Le contenu technique des publications IEC est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

Catalogue IEC - webstore.iec.ch/catalogue

Application autonome pour consulter tous les renseignements bibliographiques sur les Normes internationales, Spécifications techniques, Rapports techniques et autres documents de l'IEC. Disponible pour PC, Mac OS, tablettes Android et iPad.

Recherche de publications IEC - www.iec.ch/searchpub

La recherche avancée permet de trouver des publications IEC en utilisant différents critères (numéro de référence, texte, comité d'études,...). Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

IEC Just Published - webstore.iec.ch/justpublished

Restez informé sur les nouvelles publications IEC. Just Published détaille les nouvelles publications parues. Disponible en ligne et aussi une fois par mois par email.

Electropedia - www.electropedia.org

Le premier dictionnaire en ligne de termes électroniques et électriques. Il contient 20 000 termes et définitions en anglais et en français, ainsi que les termes équivalents dans 15 langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (IEV) en ligne.

Glossaire IEC - std.iec.ch/glossary

65 000 entrées terminologiques électrotechniques, en anglais et en français, extraites des articles Termes et Définitions des publications IEC parues depuis 2002. Plus certaines entrées antérieures extraites des publications des CE 37, 77, 86 et CISPR de l'IEC.

Service Clients - webstore.iec.ch/csc

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: csc@iec.ch.



IEC 62689-2

Edition 1.0 2016-05

INTERNATIONAL STANDARD

NORME INTERNATIONALE



**Current and voltage sensors or detectors, to be used for fault passage
indication purposes –
Part 2: System aspects**

**Capteurs ou détecteurs de courant et de tension, à utiliser pour indiquer
le passage d'un courant de défaut –
Partie 2: Aspects systèmes**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

COMMISSION
ELECTROTECHNIQUE
INTERNATIONALE

ICS 17.220.20

ISBN 978-2-8322-3385-6

**Warning! Make sure that you obtained this publication from an authorized distributor.
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

CONTENTS

FOREWORD	5
INTRODUCTION	7
1 Scope	9
2 Normative references	9
3 Terms, definitions, abbreviations and symbols	9
3.1 Terms and definitions related to neutral point treatment	10
3.2 Abbreviations and symbols	10
4 Choice of FPI/DSU requirements related to fault detection according to network operation mode and fault type	10
4.1 General	10
4.2 FPIs/DSUs for isolated neutral system	10
4.2.1 Earth fault detection	10
4.2.2 Polyphase fault detection	11
4.3 FPIs/DSUs for resonant earthed (neutral) system – arc-suppression-coil-earth (neutral) system	11
4.3.1 Earth fault detection	11
4.3.2 Polyphase fault detection	12
4.4 FPIs/DSUs for solidly earthed neutral systems (systems with low-impedance earthed neutrals)	12
4.5 FPIs/DSUs for impedance earthed neutral system (resistive impedance earthed neutral system)	12
4.5.1 Earth fault detection	12
4.5.2 Polyphase fault detection	13
4.6 FPIs/DSUs for systems with high presence of DER	13
4.7 Summary of FPI/DSU requirements with respect to fault detection according to network operation mode and fault type	13
5 Fault detecting principles according to network and fault type	15
5.1 General	15
5.2 Earth fault detection and neutral treatment	18
5.2.1 General	18
5.2.2 Earth fault detection in isolated neutral systems	18
5.2.3 Earth fault detection in resonant earthed systems	24
5.2.4 Overcurrent detection in absence or negligible presence of DER	35
5.2.5 Overcurrent detection in presence of a large amount of DER (significantly increasing short circuit current values)	37
Annex A (informative) Example of a possible solution for fault detection through FPIs/DSUs on closed loop feeder	39
A.1 General	39
A.2 Double bipole model	39
A.3 Analysis of zero-sequence values in case of fault on a line out of the closed loop	40
A.4 Analysis in case of fault on the closed-loop	42
A.5 Example of on-field application	44
Annex B (informative) Example of fault detection coordination technique among FPIs/DSUs and MV feeder protection relays	45
B.1 Autonomous fault detection confirmation from FPIs/DSUs	45

B.2 Fault detection confirmation from FPIs/DSUs through voltage presence/absence detection	48
Bibliography.....	49
Figure 1 – General architecture of an FPI	8
Figure 2 – General three-phase diagram of an earth fault in isolated neutral system.....	16
Figure 3 – General three-phase diagram of an earth fault solidly earthed system (example 2)	17
Figure 4 – Isolated neutral system – detection of earth fault current direction from FPI/DSU upstream from the fault location (fault downstream from the FPI's/DSU's location).....	18
Figure 5 – Isolated neutral system – detection of earth fault current direction from FPI/DSU downstream from the fault location (fault upstream from the FPI's/DSU's location).....	19
Figure 6 – Isolated neutral system – vector diagrams related to Figure 4 and Figure 5	20
Figure 7 – Relationship between FPI/DSU regulated current threshold and earth fault current in case of non-directional earth fault current detection. Fault downstream from FPI/DSU A4-2	21
Figure 8 – Relationship between FPI/DSU regulated current threshold and earth fault current in case of non-directional earth fault current detection. Fault downstream from FPI/DSU A4-1 and upstream from FPI/DSU A4-2	22
Figure 9 – Relationship between FPI/DSU regulated current threshold and earth fault current in case of non-directional earth fault current detection. Fault on MV busbar (upstream from any FPI/DSU)	23
Figure 10 – Pure resonant earthed system – detection of earth fault current direction from FPI/DSU upstream from the fault location (fault downstream from the FPI's/DSU's location).....	25
Figure 11 – Pure resonant earthed system – detection of earth fault current direction from FPI/DSU downstream from the fault location (fault upstream from the FPI's/DSU's location).....	25
Figure 12 – Pure resonant earthed system – vector diagrams related to Figure 10 and Figure 11	27
Figure 13 – Resonant earthed system with inductance and permanent parallel resistor – detection of phase to earth fault current direction from FPI/DSU upstream from the fault location (fault downstream from the FPI's/DSU's location).....	28
Figure 14 – Resonant earthed system with inductance with parallel resistor system – detection of phase to earth fault current direction from FPI/DSU downstream from the fault location (fault upstream from the FPI's/DSU's location).....	28
Figure 15 – Resonant earthed system with inductance with parallel resistor system – vector diagrams related to Figure 13 and Figure 14	30
Figure 16 – Earthing resistor system – detection of phase to earth fault current direction from FPI/DSU upstream from the fault location (fault downstream from the FPI's/DSU's location).....	32
Figure 17 – Earthing resistor system – detection of phase to earth fault current direction from FPI/DSU downstream from the fault location (fault upstream from the FPI's/DSU's location).....	32
Figure 18 – Earthing resistor system – vector diagrams related to Figure 16 and Figure 17	34
Figure 19 – Overcurrents in a radial network without DER – correct current detection by non-directional FPI/DSU (good sensitivity concerning overcurrent detection)	35

Figure 20 – Overcurrents in a radial network with negligible DER presence – correct current detection by non-directional FPI/DSU (good sensitivity concerning overcurrent detection)	36
Figure 21 – Overcurrents in a radial network with a large amount of DER – unreliable fault detection by non-directional FPIs/DSUs (incorrect detection or extremely low sensitivity)	38
Figure A.1 – Double bipole.....	39
Figure A.2 – Cascade of double bipoles	41
Figure A.3 – Closed loop double bipoles	43
Figure A.4 – Equivalent model in case of fault	43
Figure B.1 – Correctly coordinated fault selection among FPIs/DSUs and protection relay	46
Figure B.2 – Incorrectly coordinated selection among FPIs/DSUs and protection relay. Case 1	47
Figure B.3 – Incorrectly coordinated fault selection among FPIs/DSUs and protection relay. Case 2	48
Table 1 – Summary of FPI/DSU requirements referred to fault detection according to network operation mode and fault type.....	14

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**CURRENT AND VOLTAGE SENSORS OR DETECTORS,
TO BE USED FOR FAULT PASSAGE INDICATION PURPOSES –**

Part 2: System aspects

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 62689-2 has been prepared by IEC technical committee 38: Instrument transformers.

The text of this standard is based on the following documents:

FDIS	Report on voting
38/504/FDIS	38/511/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all the parts in the IEC 62689 series, under the general title *Current and voltage sensors or detectors, to be used for fault passage indication purposes*, can be found on the IEC website.

The committee has decided that the contents of this publication will remain unchanged until the stability date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

INTRODUCTION

0.1 General

The IEC 62689 series is a product family standard for current and voltage sensors or detectors, to be used for fault passage indication purposes by proper devices or functions, indicated as fault passage indicator (FPI) or distribution substation unit (DSU), depending on their performances.

Different names are used to indicate FPIs depending on the region of the world and on their functionalities concerning capability to detect different kinds of faults, for instance:

- fault detector;
- smart sensor;
- faulted circuit indicator (FCI);
- short circuit indicator (SCI);
- earth fault indicator (EFI);
- test point mounted FCI.
- combination of the above.

Simpler versions, only using local information/signals and/or local communication, are called FPI, while very evolved versions are called DSU. The latter are explicitly designed for smart grids and based on IEC 60870-5 and IEC 61850 communication protocols. Compared to instrument transformers, digital communication technology is subject to on-going changes which are expected to continue in the future.


Profound experience with deep integration between electronics and instrument transformers has yet to be gathered on a broader basis, as this type of equipment is not yet widespread in the industry.

DSUs, besides FPI basic functions, may also optionally integrate additional auxiliary functions such as:

- voltage presence/absence detection for medium voltage (MV) network automation, with and without distributed energy resources presence (not for fault confirmation, which can be a basic FPI function depending on the adopted fault detection method, neither for safety-related aspects, which are covered by IEC 61243-5);
- measuring of voltage, current, and active and reactive power, etc., for various applications, such as MV network automation, monitoring of power flows, etc.;
- smart grid management (such as voltage control and unwanted island operation) by means of a proper interface with local distributed generators (DER);
- local output of collected information by means of suitable interfaces;
- remote transmission of collected information;
- others.

A general FPI scheme is outlined in Figure 1.

A DSU may have a much more complex scheme.

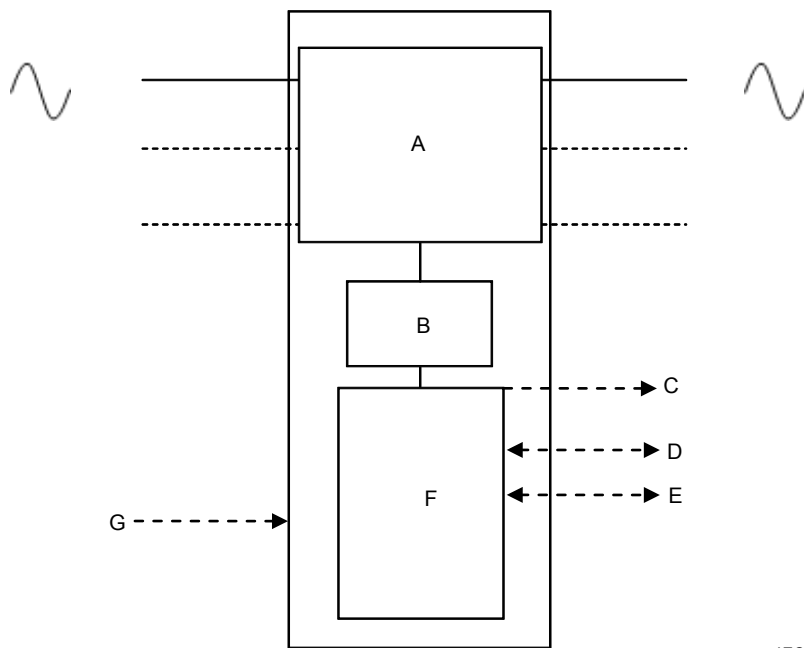

IEC

Key

- A Current (and, if necessary, voltage) sensors. 1 or 3 phases may be monitored.
- B Transmission of signals between sensors and electronics.
- C: Local indications (lamps, LEDs, flags, etc.).
- D Analogue, digital and/or communication inputs/outputs for remote communication/commands (hard wired and/or wireless).
- E Connections to field apparatus.
- F Signal conditioning, processing and indicating unit (CPIU).
- G Power supply.

Current sensor(s) may detect fault current passages without any need of galvanic connection to the phase(s) (for instance in case of cable type current sensors or of magnetic field sensor).

Not all the above listed parts or functions are necessarily included in the FPI, depending on its complexity and on its technology. However, at least 1 one of C or D functions shall be present.

Figure 1 – General architecture of an FPI

0.2 Position of this standard in relation to the IEC 61850 series

The IEC 61850 series is intended to be used for communication and systems to support power utility automation.

The IEC 62689 series will also introduce a dedicated namespace to support integration of FPIs/DSUs into power utility automation.

In addition, it defines proper data models and different profiles of communication interfaces to support the different use cases of these FPIs/DSUs.

Some of these use cases rely on the concept of extended substation, which is intended as the communication among intelligent electronic devices (IED) through IEC 61850 located both along MV feeders and in the main substation, for the most sophisticated FPI versions (and therefore DSUs) (for smart grid applications, for instance). Such a profile may not be limited to FPI/DSU devices, but may embrace features needed to support extensions of these substations along the MV feeders connected to the main substation themselves.

CURRENT AND VOLTAGE SENSORS OR DETECTORS, TO BE USED FOR FAULT PASSAGE INDICATION PURPOSES –

Part 2: System aspects

1 Scope

This part of IEC 62689 describes electric phenomena and electric system behaviour during faults, according to the most widely diffused distribution system architecture and to fault typologies, to define the functional requirements for fault passage indicators (FPI) and distribution substation units (DSU) (including their current and/or voltage sensors), which are, respectively, a device or a device/combination of devices and/or of functions able to detect faults and provide indications about their localization.

By localization of the fault is meant the fault position with respect to the FPI/DSU installation point on the network (upstream or downstream from the FPI/DSU's location) or the direction of the fault current flowing through the FPI itself. The fault localization may be obtained

- directly from the FPI/DSU, or
- from a central system using information from more FPIs or DSUs,

considering the features and the operating conditions of the electric system where the FPIs/DSUs are installed.

This part of IEC 62689 is therefore aimed at helping users in the appropriate choice of FPIs/DSUs (or of a system based on FPI/DSU information) properly operating in their networks, considering adopted solutions and operation rules (defined by tradition and/or depending on possible constraints concerning continuity and quality of voltage supply defined by a national regulator), and also taking into account complexity of the apparatus and consequent cost.

This part of IEC 62689 is mainly focused on system behaviour during faults, which is the "core" of FPI/DSU fault detection capability classes described in IEC 62689-1, where all requirements are specified in detail.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 62689-1, *Current and voltage sensors or detectors, to be used for fault passage indication purposes – Part 1: General principles and requirements*

3 Terms, definitions, abbreviations and symbols

For the purposes of this document, the terms and definitions given in IEC 62689-1 and the following apply.

This is a free preview. Purchase the entire publication at the link below:

[Product Page](#)

-
- [Looking for additional Standards? Visit Intertek Inform Infostore](#)
 - [Learn about LexConnect, All Jurisdictions, Standards referenced in Australian legislation](#)
-