



**NSAI**  
Standards

Irish Standard Recommendation  
S.R. CLC/TR 50600-99-1:2017

Information technology - Data centre facilities and infrastructures - Part 99-1: Recommended practices for energy management

**S.R. CLC/TR 50600-99-1:2017**

*Incorporating amendments/corrigenda/National Annexes issued since publication:*

The National Standards Authority of Ireland (NSAI) produces the following categories of formal documents:

I.S. xxx: Irish Standard — national specification based on the consensus of an expert panel and subject to public consultation.

S.R. xxx: Standard Recommendation — recommendation based on the consensus of an expert panel and subject to public consultation.

SWiFT xxx: A rapidly developed recommendatory document based on the consensus of the participants of an NSAI workshop.

*This document replaces/revises/consolidates the NSAI adoption of the document(s) indicated on the CEN/CENELEC cover/Foreword and the following National document(s):*

*NOTE: The date of any NSAI previous adoption may not match the date of its original CEN/CENELEC document.*

*This document is based on:*

CLC/TR 50600-99-1:2017

*Published:*

2017-04-14

*This document was published under the authority of the NSAI and comes into effect on:*

2017-05-02

ICS number:

35.020

35.110

35.160

NOTE: If blank see CEN/CENELEC cover page

NSAI  
1 Swift Square,  
Northwood, Santry  
Dublin 9

T +353 1 807 3800  
F +353 1 807 3838  
E standards@nsai.ie  
W NSAI.ie

Sales:  
T +353 1 857 6730  
F +353 1 857 6729  
W standards.ie

Údarás um Chaighdeáin Náisiúnta na hÉireann

## National Foreword

S.R. CLC/TR 50600-99-1:2017 is the adopted Irish version of the European Document CLC/TR 50600-99-1:2017, Information technology - Data centre facilities and infrastructures - Part 99-1: Recommended practices for energy management

This document does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

For relationships with other publications refer to the NSAI web store.

**Compliance with this document does not of itself confer immunity from legal obligations.**

*In line with international standards practice the decimal point is shown as a comma (,) throughout this document.*

This page is intentionally left blank

TECHNICAL REPORT  
RAPPORT TECHNIQUE  
TECHNISCHER BERICHT

**CLC/TR 50600-99-1**

April 2017

ICS 35.020; 35.110; 35.160

Supersedes CLC/TR 50600-99-1:2016

English Version

**Information technology - Data centre facilities and infrastructures  
- Part 99-1: Recommended practices for energy management**

Technologies de l'information - Installations et  
infrastructures de centres de traitement de données - Partie  
99-1 : Pratiques recommandées relatives à la gestion  
énergétique

Informationstechnik - Einrichtungen und Infrastrukturen von  
Rechenzentren - Teil 99-1: Empfohlene Praktiken für das  
Energiemanagement

This Technical Report was approved by CENELEC on 2017-04-17.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.



European Committee for Electrotechnical Standardization  
Comité Européen de Normalisation Electrotechnique  
Europäisches Komitee für Elektrotechnische Normung

**CEN-CENELEC Management Centre: Avenue Marnix 17, B-1000 Brussels**

## Contents

Page

European foreword.....	3
Introduction.....	4
1 Scope.....	7
2 Normative references.....	7
3 Terms, definitions and abbreviations .....	8
3.1 Terms and definitions.....	8
3.2 Abbreviations .....	11
4 Principles .....	12
4.1 General.....	12
4.2 Data centre utilization, management and planning.....	12
4.3 Data centre ICT equipment and services.....	13
4.4 Data centre cooling equipment .....	13
4.5 Data centre power equipment.....	15
4.6 Other data centre equipment.....	15
4.7 Data centre building .....	15
4.8 Data centre monitoring.....	16
5 Expected Practices.....	16
5.1 Existing data centres .....	16
5.2 ICT equipment (new or replacement).....	22
5.3 Software install or upgrade.....	27
5.4 New build or refurbishment of data centres .....	27
6 Optional and alternative Practices .....	35
6.1 Existing data centres .....	35
6.2 ICT equipment (new or replacement).....	42
6.3 Software install or upgrade.....	43
6.4 New build or refurbishment of data centres .....	44
7 Practices under consideration .....	49
7.1 Practices expected to be included in Clause 5 in due course.....	49
7.2 Practices expected to be included in Clause 6 in due course.....	50
Annex A (informative) Environmental classifications .....	51
A.1 ASHRAE classifications .....	51
A.2 ETSI EN 300 019-1-3 classifications.....	52
Bibliography.....	53

## **European foreword**

This document (CLC/TR 50600-99-1:2017) has been prepared by CLC/TC 215 “Electrotechnical aspects of telecommunication equipment” in conjunction with the Directorate-General Joint Research Centre (DG JRC) of the European Commission (EC).

This document supersedes CLC/TR 50600-99-1:2016.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CENELEC shall not be held responsible for identifying any or all such patent rights.

CLC/TR 50600-99-1:2017 includes the following significant technical changes with respect to CLC/TR 50600-99-1:2016 which it supersedes:

- by updating to recently agreed energy management practices and aligns with the 2017 edition of the EU Code of Conduct for data centres Best Practices document.

This document aligns with the Best Practices document of the Code of Conduct for Data Centre Energy Efficiency (CoC) scheme operated by the DG JRC and continues to be prepared by data centre experts from operators, vendors, consultants, academics, professional and national bodies.

The publication of this Technical Report is intended to integrate recommended Practices of energy management into the EN 50600 series of standards developed by CLC/TC 215 and also to widen accessibility and increase participation in the CoC scheme by ensuring translation of the Best Practices into multiple languages.

This document has been prepared under a mandate given to CENELEC by the European Commission and the European Free Trade Association.

Regarding the structure of the EN 50600 series, see the Introduction.

## **CLC/TR 50600-99-1:2017**

### **Introduction**

The unrestricted access to internet-based information demanded by the information society has led to an exponential growth of both internet traffic and the volume of stored/retrieved data. Data centres are housing and supporting the information technology and network telecommunications equipment for data processing, data storage and data transport. They are required both by network operators (delivering those services to customer premises) and by enterprises within those customer premises.

Data centres need to provide modular, scalable and flexible facilities and infrastructures to easily accommodate the rapidly changing requirements of the market. In addition, energy consumption of data centres has become critical both from an environmental point of view (reduction of carbon footprint) and with respect to economic considerations (cost of energy) for the data centre operator.

The implementation of data centres varies in terms of:

- a) purpose (enterprise, co-location, co-hosting, or network operator facilities);
- b) security level;
- c) physical size;
- d) accommodation (mobile, temporary and permanent constructions).

The needs of data centres also vary in terms of availability of service, the provision of security and the objectives for energy efficiency. These needs and objectives influence the design of data centres in terms of building construction, power distribution, environmental control and physical security. Effective management and operational information is required to monitor achievement of the defined needs and objectives.

This series of European Standards specifies requirements and recommendations to support the various parties involved in the design, planning, procurement, integration, installation, operation and maintenance of facilities and infrastructures within data centres. These parties include:

- 1) owners, facility managers, ICT managers, project managers, main contractors;
- 2) architects, consultants, building designers and builders, system and installation designers;
- 3) facility and infrastructure integrators, suppliers of equipment;
- 4) installers, maintainers.

At the time of publication of this Technical Report, EN 50600 series will comprise the following standards and documents:

EN 50600-1, *Information technology — Data centre facilities and infrastructures — Part 1: General concepts*;

EN 50600-2-1, *Information technology — Data centre facilities and infrastructures — Part 2-1: Building construction*;

EN 50600-2-2, *Information technology — Data centre facilities and infrastructures — Part 2-2: Power distribution*;

EN 50600-2-3, *Information technology — Data centre facilities and infrastructures — Part 2-3: Environmental control*;

EN 50600-2-4, *Information technology — Data centre facilities and infrastructures — Part 2-4: Telecommunications cabling infrastructure*;

EN 50600-2-5, *Information technology — Data centre facilities and infrastructures — Part 2-5: Security systems*;



EN 50600-3-1, *Information technology — Data centre facilities and infrastructures — Part 3-1: Management and operational information*;


EN 50600-4-1, *Information technology — Data centre facilities and infrastructures — Part 4-1: Overview of and general requirements for key performance indicators*;

EN 50600-4-2, *Information technology — Data centre facilities and infrastructures — Part 4-2: Power Usage Effectiveness*;

EN 50600-4-3, *Information technology — Data centre facilities and infrastructures — Part 4-3: Renewable Energy Factor*;

CLC/TR 50600-99-1, *Information technology — Data centre facilities and infrastructures — Part 99-1: Recommended practices for energy management*.

The inter-relationship of the standards within the EN 50600 series is shown in Figure 1.

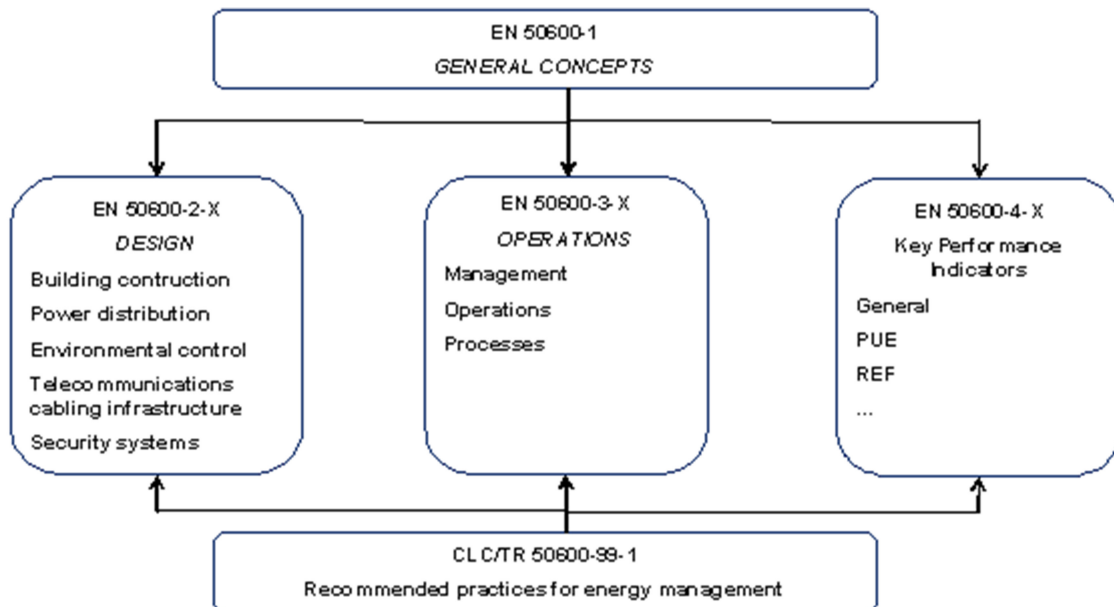

**Figure 1 — Schematic relationship between the EN 50600 series of documents**

EN 50600-2-X standards specify requirements and recommendations for particular facilities and infrastructures to support the relevant classification for “availability”, “physical security” and “energy efficiency enablement” selected from EN 50600-1.

EN 50600-3-X documents specify requirements and recommendations for data centre operations, processes and management.

EN 50600-4-X documents specify requirements and recommendations for key performance indicators (KPIs) used to assess and improve the resource usage efficiency and effectiveness, respectively, of a data centre.

The Directorate-General Joint Research Centre (DG JRC) of the European Commission operates a Code of Conduct for Data Centre Energy Efficiency (CoC) scheme. In support of the scheme, a “best practices” document has been established by DG JRC. To enhance the visibility, these Best Practices have been converted in this Technical Report to create recommended Practices for improving the energy management (i.e. reduction of energy consumption and/or increases in energy efficiency) of data centres.

## **CLC/TR 50600-99-1:2017**

The areas addressed are:

- physical building;
- mechanical and electrical equipment;
- computer room;
- cabinets/racks;
- ICT equipment;
- operating systems;
- virtualization;
- software;
- business practices.

The Practices are separated into Expected Practices as referenced in the CoC (see Clause 5) and other Practices which can be employed as optional or alternative solutions in particular cases (see Clause 6). Practices under consideration for the next or future revision/amendment of this Technical Report are included in Clause 7. During the maintenance of this Technical Report, the Practices of Clauses 6 and 7 might be augmented and others might migrate into Clause 5.

The Practices listed in Clauses 5, 6 and 7 are referenced as x.17.yyy where x is the clause number, 17 refers to the 2017 publication of this document and yyy is a sequential number starting within each clause. Also included is the CoC BP reference (as used in 2017) in order to provide an audit trail. Future versions of this document will use these references to track changes in the Practices, provide a historic record and to simplify translation of the document.

Customers or suppliers of information and communication technology (ICT) services might also find it useful to request or provide a list of the Practices of this Technical Report that are implemented in a data centre to assist in procurement of services that meet their environmental or sustainability standards.

This Technical Report also:

- acts as an education and reference document to assist data centre operators in identifying and implementing measures to improve the energy management of their data centres;
- provides a common terminology and frame of reference for describing an energy management practice, avoiding doubt or confusion over terminology.

## 1 Scope

This Technical Report is a compilation of recommended Practices for improving the energy management (i.e. reduction of energy consumption and/or increases in energy efficiency) of data centres. It is aligned with the EU Code of Conduct for Data Centre Energy Efficiency (CoC) scheme operated by the Directorate-General Joint Research Centre (DG JRC) of the European Commission (EC).

It is recognized that the Practices included might not be universally applicable to all scales and business models of data centres or be undertaken by all parties involved in data centre operation, ownership or use.

## 2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 50600-1:2012, *Information technology - Data centre facilities and infrastructures - Part 1: General concepts*

EN 50600-2-1, *Information technology - Data centre facilities and infrastructures - Part 2-1: Building construction*

EN 50600-2-2, *Information technology - Data centre facilities and infrastructures - Part 2-2: Power distribution*

EN 50600-2-3, *Information technology - Data centre facilities and infrastructures - Part 2-3: Environmental control*

EN 50600-2-4, *Information technology - Data centre facilities and infrastructures - Part 2-4: Telecommunications cabling infrastructure*

EN 50600-2-5, *Information technology - Data centre facilities and infrastructures - Part 2-5: Security systems*

EN 50600-3-1, *Information technology - Data centre facilities and infrastructures - Part 3-1: Management and operational information*

EN 50600-4-1, *Information technology - Data centre facilities and infrastructures - Part 4-1: Overview of and general requirements for key performance indicators*

EN 50600-4-2, *Information technology - Data centre facilities and infrastructures - Part 4-2: Power Usage Effectiveness*

EN 50600-4-3, *Information technology - Data centre facilities and infrastructures - Part 4-3: Renewable Energy Factor*

This is a free preview. Purchase the entire publication at the link below:

[Product Page](#)

- 
- [Looking for additional Standards? Visit Intertek Inform Infostore](#)
  - [Learn about LexConnect, All Jurisdictions, Standards referenced in Australian legislation](#)
-