



NSAI
Standards

Irish Standard
I.S. EN 13141-7:2021

Ventilation for buildings - Performance testing of components/products for residential ventilation - Part 7:
Performance testing of ducted mechanical supply and exhaust ventilation units (including heat recovery)

I.S. EN 13141-7:2021

Incorporating amendments/corrigenda/National Annexes issued since publication:

The National Standards Authority of Ireland (NSAI) produces the following categories of formal documents:

I.S. xxx: Irish Standard — national specification based on the consensus of an expert panel and subject to public consultation.

S.R. xxx: Standard Recommendation — recommendation based on the consensus of an expert panel and subject to public consultation.

SWiFT xxx: A rapidly developed recommendatory document based on the consensus of the participants of an NSAI workshop.

This document replaces/revises/consolidates the NSAI adoption of the document(s) indicated on the CEN/CENELEC cover/Foreword and the following National document(s):

NOTE: The date of any NSAI previous adoption may not match the date of its original CEN/CENELEC document.

This document is based on:

EN 13141-7:2021

Published:

2021-04-14

*This document was published
under the authority of the NSAI
and comes into effect on:*

2021-05-06

ICS number:

91.140.30

NOTE: If blank see CEN/CENELEC cover page

NSAI
1 Swift Square,
Northwood, Santry
Dublin 9

T +353 1 807 3800
F +353 1 807 3838
E standards@nsai.ie
W NSAI.ie

Sales:
T +353 1 857 6730
F +353 1 857 6729
W standards.ie

Údarás um Chaighdeáin Náisiúnta na hÉireann

National Foreword

I.S. EN 13141-7:2021 is the adopted Irish version of the European Document EN 13141-7:2021, Ventilation for buildings - Performance testing of components/products for residential ventilation - Part 7: Performance testing of ducted mechanical supply and exhaust ventilation units (including heat recovery)

This document does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

For relationships with other publications refer to the NSAI web store.

Compliance with this document does not of itself confer immunity from legal obligations.

In line with international standards practice the decimal point is shown as a comma (,) throughout this document.

This page is intentionally left blank

EUROPEAN STANDARD

EN 13141-7

NORME EUROPÉENNE

EUROPÄISCHE NORM

April 2021

ICS 91.140.30

Supersedes EN 13141-7:2010

English Version

**Ventilation for buildings - Performance testing of
components/products for residential ventilation - Part 7:
Performance testing of ducted mechanical supply and
exhaust ventilation units (including heat recovery)**

Ventilation des bâtiments - Essais de performance des
composants/produits pour la ventilation des
logements - Partie 7 : Essais de performance des
centrales double flux (y compris la récupération de
chaleur)

Lüftung von Gebäuden - Leistungsprüfungen von
Bauteilen/Produkten für die Lüftung von Wohnungen -
Teil 7: Leistungsprüfung von mechanischen Zuluft- und
Ablufteinheiten (einschließlich Wärmerückgewinnung)

This European Standard was approved by CEN on 25 January 2021.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

EN 13141-7:2021 (E)

Contents	Page
European foreword.....	4
Introduction	6
1 Scope	8
2 Normative references	8
3 Terms and definitions	9
4 Symbols and abbreviations	13
5 Categories of heat exchangers.....	16
6 Requirements	16
7 Test methods	18
7.1 General.....	18
7.2 Performance testing of aerodynamic characteristics.....	18
7.2.1 Leakages	18
7.2.2 Air flow/pressure curve	20
7.2.3 Electrical power input.....	25
7.2.4 Filter bypass.....	25
7.3 Performance testing of thermal characteristics	26
7.3.1 General.....	26
7.3.2 Test operating conditions	26
7.3.3 Temperature conditions.....	27
7.3.4 Test procedure	29
7.3.5 Evaluation on supply air side (mandatory measurement)	30
7.3.6 Evaluation on exhaust air side (optional measurement)	31
7.3.7 Heat pump performance	31
7.3.8 Combined heat pump and air-to-air heat exchanger performance	32
7.4 Performance testing of acoustic characteristics.....	32
7.4.1 General.....	32
7.4.2 Noise radiated through the casing of the unit.....	32
7.4.3 Sound power level in duct connections of the unit.....	34
8 Test results	37
8.1 Test report.....	37
8.2 Product specifications	37
8.3 Leakages	37
8.4 Air flow/pressure curve	38
8.5 Heat pump exhaust air/outdoor air performances.....	38
8.6 Temperature ratios	38
8.7 Acoustic characteristics.....	39
8.8 Electrical power input.....	39
Annex A (informative) Example of some possible arrangements of heat recovery heat exchanger and/or heat pumps for category I	40
Annex B (normative) Pressure leakage test method	42
B.1 External leakage	42
B.2 Internal leakage test	42

Annex C (normative) Tracer gas test method.....	44
C.1 General method for rating purposes	44
C.2 Augmented method for measuring instantaneous recirculation of ducted units under different operating conditions (optional)	45
C.3 Testing orders for tracer gas tests.....	46
Annex D (normative) Evaluation of maximum air volume flow and pressure.....	49
Annex E (normative) Evaluation of reference pressure	51
Annex F (normative) Connection boxes	52
Bibliography	54

EN 13141-7:2021 (E)

European foreword

This document (EN 13141-7:2021) has been prepared by Technical Committee CEN/TC 156 “Ventilation for buildings”, the secretariat of which is held by BSI.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by October 2021, and conflicting national standards shall be withdrawn at the latest by October 2021.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN 13141-7:2010.

In addition to a number of editorial revisions, the following main changes have been made with respect to EN 13141-7:2010:

- terms and definitions as well as the symbols and abbreviations have been updated in accordance with the parameters used in the document;
- new categories of heat exchanger have been added;
- general requirements of the static pressure distribution have been added in 7.1;
- the reference of the internal and external leakage rates has been changed to the reference air volume flow;
- requirements to convert the measured values to standard conditions have been added in 7.2.2.1 and 7.3.2;
- determination of the external static pressure difference, maximum air flow and reference air flow has been added;
- 7.3.3 has been divided into two separate subclauses, 7.3.3.1 for standard tests and 7.3.3.2 for cold climate tests;
- the formulas to calculate the temperature ratios have been changed;
- the wet bulb temperature for the cold climate test has been changed;
- Annex D, giving examples for the evaluation of maximum air volume flow and pressure, has been added;
- Annex E giving examples for the evaluation of reference pressure has been added;
- the description of the connection box has been moved to Annex F.

A list of all parts in the EN 13141 series, published under the general title *Ventilation for buildings — Performance testing of components/products for residential ventilation* can be found on the CEN website.

According to the CEN-CENELEC Internal Regulations, the national standards organisations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

EN 13141-7:2021 (E)

Introduction

This document specifies methods for the performance testing of components used in residential ventilation systems to establish the performance characteristics as identified in EN 13142:2021.

This document does not contain any information on ductwork and fittings, which are covered by other European Standards.

This document can be used for the following applications:

- laboratory testing;
- attestation purposes.

The position of this document in the field of standards for the mechanical building services is shown in Figure 1.

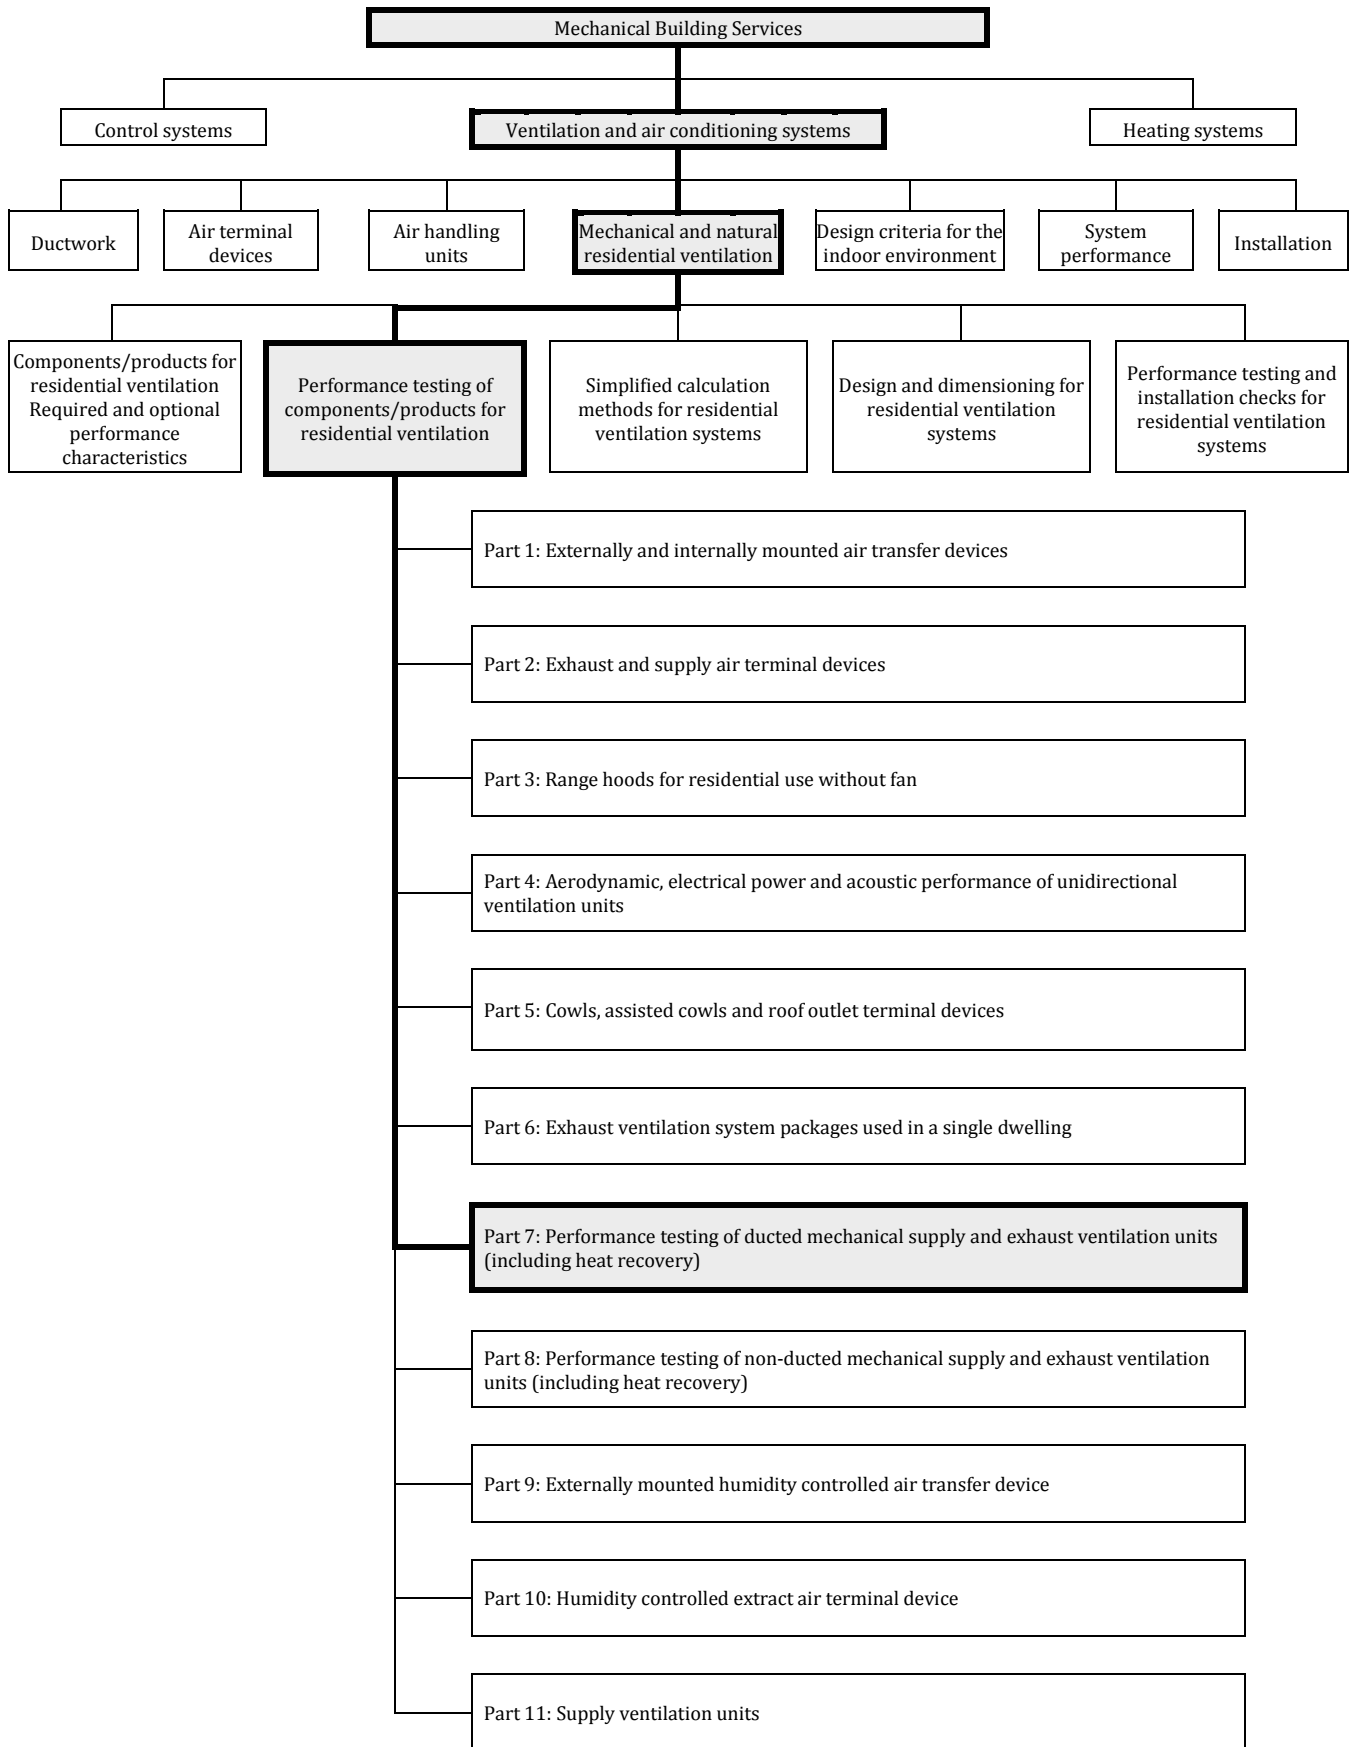


Figure 1 — Position of EN 13141-7 in the field of the mechanical building services

EN 13141-7:2021 (E)**1 Scope**

This document specifies the laboratory test methods and test requirements for the testing of aerodynamic, thermal, acoustic and electrical performance characteristics of ducted mechanical supply and exhaust residential ventilation units.

NOTE Such units are referred to as bidirectional ventilation units in EN 13142:2021.

This document is applicable to unit that contain at least, within one or more casing:

- fans for mechanical supply and exhaust;
- air filters;
- air-to-air heat exchanger and/or air-to-air heat pump for air heat recovery;
- control system.

Such unit can be provided in more than one assembly, the separate assemblies of which are designed to be used together.

Examples of different possible arrangements of heat recovery, heat exchangers and/or heat pumps are described in Annex A.

This document covers ventilation units with continuous mass flows for each setting point.

This document does not deal with non-ducted units that are treated in prEN 13141-8:2021.

This document does not cover ventilation systems that may also provide water space heating and hot water that are treated in EN 16573.

This document does not cover units including combustion engine driven compression heat pumps and absorption heat pumps.

Electrical safety requirements are given in EN 60335-2-40 and EN 60335-2-80.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 12792, *Ventilation for buildings — Symbols, terminology and graphical symbols*

EN 14511 (all parts), *Air conditioners, liquid chilling packages and heat pumps with electrically driven compressors for space heating and cooling and process chillers, with electrically driven compressors*

EN 14511-3, *Air conditioners, liquid chilling packages and heat pumps for space heating and cooling and process chillers, with electrically driven compressors — Part 3: Test methods*

EN 14511-4, *Air conditioners, liquid chilling packages and heat pumps for space heating and cooling and process chillers, with electrically driven compressors — Part 4: Requirements*

EN ISO 5135, *Acoustics — Determination of sound power levels of noise from air-terminal devices, air-terminal units, dampers and valves by measurement in a reverberation test room (ISO 5135)*

EN ISO 5136, *Acoustics — Determination of sound power radiated into a duct by fans and other air-moving devices — In-duct method (ISO 5136)*

This is a free preview. Purchase the entire publication at the link below:

[Product Page](#)

-
- Looking for additional Standards? Visit Intertek Inform Infostore
 - Learn about LexConnect, All Jurisdictions, Standards referenced in Australian legislation
-