



National Standards Authority of Ireland

IRISH STANDARD

I.S. EN 13154-1:2001

ICS 35 240 99
97 120

National Standards
Authority of Ireland
Dublin 4

Tel: 01 708 1100
Tel: 01 708 1101

**DATA COMMUNICATION FOR HVAC
APPLICATION - FIELD NET - PART 1:
OBJECTS**

*This Irish Standard was
published under the
authority of the National
Standards Authority of
Ireland
and comes into effect on*

**NO COPYING WITHOUT NSAI
PERMISSION EXCEPT AS
PERMITTED BY COPYRIGHT
LAW**

© NSAI 2001

Price Code U

Údarás um Chaighdeáin Náisiúnta na hÉireann

EUROPEAN PRESTANDARD
PRÉNORME EUROPÉENNE
EUROPÄISCHE VORNORM

ENV 13154-1

October 2000

ICS 35.240.99; 97.120

English version

Data communication for HVAC application - Field net - Part 1: Objects

This European Prestandard (ENV) was approved by CEN on 18 September 2000 as a prospective standard for provisional application.

The period of validity of this ENV is limited initially to three years. After two years the members of CEN will be requested to submit their comments, particularly on the question whether the ENV can be converted into a European Standard.

CEN members are required to announce the existence of this ENV in the same way as for an EN and to make the ENV available promptly at national level in an appropriate form. It is permissible to keep conflicting national standards in force (in parallel to the ENV) until the final decision about the possible conversion of the ENV into an EN is reached.

CEN members are the national standards bodies of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPAISCHES KOMITEE FÜR NORMUNG

Central Secretariat: rue de Stassart, 36 B-1050 Brussels

Contents

1	SCOPE	6
2	NORMATIVE REFERENCE	7
3	TERMS AND DEFINITIONS	8
4	GENERAL REQUIREMENTS	9
4.1	SYSTEM OVERVIEW	9
4.2	ASPECTS OF APPLICATION.....	9
4.3	OBJECT MODEL	9
4.4	OBJECT STRUCTURE	12
4.5	INTERACTION MODEL	12
5	THE FIELD LEVEL OBJECTS	13
5.1	DEVICE OBJECT.....	13
5.1.1	Mandatory Properties.....	14
5.1.2	Optional Properties	15
5.1.3	Engineerable Properties.....	16
5.2	ANALOGUE OBJECT.....	17
5.2.1	Mandatory Properties.....	17
5.2.2	Optional Properties	19
5.2.3	Engineerable Properties.....	22
5.3	BINARY OBJECT.....	23
5.3.1	Mandatory Properties.....	24
5.3.2	Optional Properties	25
5.3.3	Engineerable Properties.....	26
5.4	COUNTER OBJECT	27
5.4.1	Mandatory Properties.....	27
5.4.2	Optional Properties	28
5.4.3	Engineerable Properties.....	29
5.5	LOOP OBJECT.....	30
5.5.1	Mandatory Properties.....	30
5.5.2	Optional Properties	31
5.5.3	Engineerable Properties.....	33
5.6	MULTISTATE OBJECT	35
5.6.1	Mandatory Properties.....	36
5.6.2	Optional Properties	36
5.6.3	Engineerable Properties.....	37
5.7	ALARM AND COV NOTIFICATION.....	38
5.7.1	Alarm Notification.....	38
5.7.2	COV Notification.....	41
5.7.3	Unsolicited messaging to reduce network traffic	41
6	ANNEX A. GUIDELINES (INFORMATIVE)	42
6.1	EXAMPLES FOR THE INTENDED USE OF THIS PRESTANDARD AS MENTIONED IN THE INTRODUCTION	42
6.1.1	API on superordinate system unit.....	42
6.1.2	Interface to communication-front-end.....	42
6.1.3	Building a field level gateway	43
6.1.4	Topology model.....	44
6.2	MAPPING GUIDELINES.....	44
6.2.1	Mapping objects.....	44
6.2.2	Mapping services	45
6.3	POSSIBLE FUTURE EXTENSIONS	46
7	ANNEX B. DATATYPES (INFORMATIVE)	47

7.1	BASIC DATATYPES	47
7.1.1	BITSTRING	47
7.1.2	BOOLEAN	47
7.1.3	CharacterString	47
7.1.4	Date	47
7.1.5	ENUMERATED	47
7.1.6	Float	47
7.1.7	INTEGER	47
7.1.8	NULL	47
7.1.9	OCTETSTRING	48
7.1.10	Signed	48
7.1.11	Time	48
7.1.12	Unsigned	48
7.2	APPLICATION DATATYPES	48
7.2.1	Object_ID_Number	48
7.2.2	Object_Type	48
7.2.3	Object_Name	50
7.2.4	Value_Presentation	50
7.2.5	Present_Value	50
7.2.6	Status_Information	51
7.2.7	Units	52
7.2.8	Statetext	56
7.2.9	Setpoint	60
7.2.10	Device_Type_Description	60
7.2.11	Device_Status	61
8	ANNEX C. MAPPING TO EIB (INFORMATIVE)	62
8.1	INTRODUCTION	62
8.2	REFERENCES	62
8.3	OBJECT STRUCTURE	62
8.3.1	Object Identifier	62
8.3.2	Property-Types	63
8.4	OBJECTS AND PROPERTIES	64
8.4.1	Relationship between EIB Objects and FLN Object Types	64
8.4.2	Relationship between EIB Object and FLN Object Properties	65
8.5	CONVERSION OF EIB-OBJECTS TO FLN-OBJECTS	67
8.5.1	Analogue Input/Output/Value Object	67
8.5.2	Binary Input/Output/Value	67
8.5.3	Counter Object	68
8.5.4	Device Object	68
8.5.5	Multistate Object	69
8.5.6	Loop Object	69
8.5.7	Alarm and COV Notification	70
9	ANNEX D. MAPPING TO LON (INFORMATIVE)	71
10	ANNEX E. MAPPING TO BACNET (INFORMATIVE)	72
11	ANNEX F. DISCUSSION OF THE DEVIATIONS FROM FIELD LEVEL OBJECTS TO BACNET (INFORMATIVE)	73
	BIBLIOGRAPHY	74

Foreword

This European Prestandard has been prepared by Technical Committee CEN/TC 247 "Controls for mechanical building services", the secretariat of which is held by SNV.

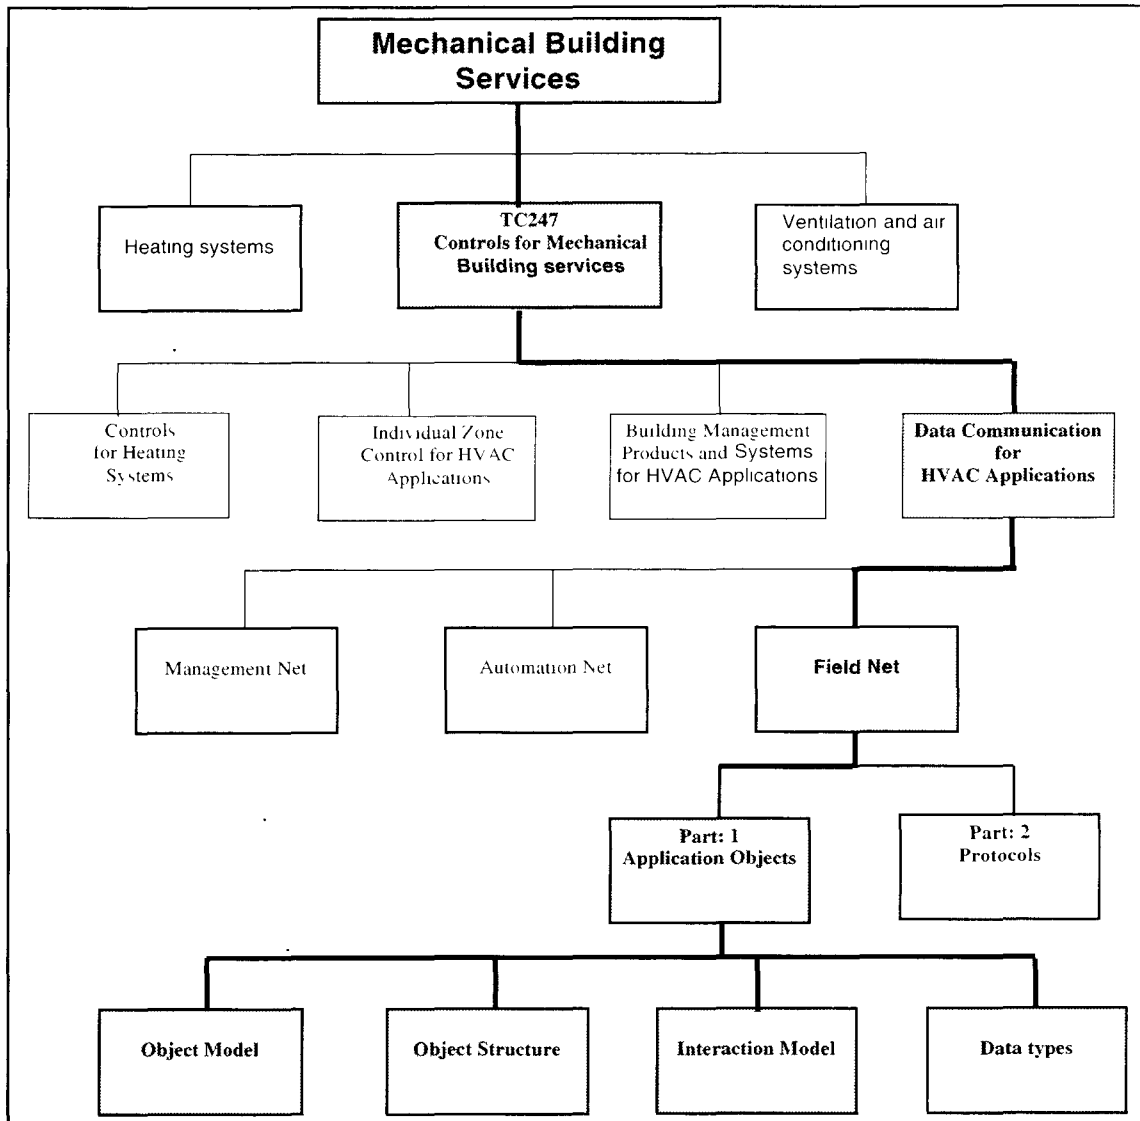


Figure 1: Structure of the standards prepared by CEN TC 247

The shaded boxes indicate the contents and hierarchy of this prestandard. The plain areas show the positioning of this prestandard with respect to other relevant mechanical building services standards.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to announce this European Prestandard: Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and the United Kingdom.

This is a free preview. Purchase the entire publication at the link below:

[Product Page](#)

-
- [Looking for additional Standards? Visit Intertek Inform Infostore](#)
 - [Learn about LexConnect, All Jurisdictions, Standards referenced in Australian legislation](#)
-