



National Standards Authority of Ireland

IRISH STANDARD

I.S. EN 50173:1997

ICS 35.020

National Standards
Authority of Ireland
Dublin 9
Ireland

Tel: (01) 807 3800
Tel: (01) 807 3838

**INFORMATION TECHNOLOGY
GENERIC CABLING SYSTEMS**

*This Irish Standard was
published under the
authority of the National
Standards Authority of
Ireland
and comes into effect on
December 2, 1997*

**NO COPYING WITHOUT NSAI
PERMISSION EXCEPT AS
PERMITTED BY COPYRIGHT
LAW**

© NSAI 1997

Price Code U

Údarás um Chaighdeáin Náisiúnta na hÉireann

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

EN 50173/A1

January 2000

ICS 33.040.50

English version

Information technology - Generic cabling systems

Technologies de l'information
Systèmes génériques de câblage

Informationstechnik
Anwendungsneutrale
Verkabelungssysteme

This amendment A1 modifies the European Standard EN 50173:1995; it was approved by CENELEC on 2000-01-01. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this amendment the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CENELEC member.

This amendment exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the Central Secretariat has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and United Kingdom.

CENELEC

European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique
Europäisches Komitee für Elektrotechnische Normung

Central Secretariat: rue de Stassart 35, B - 1050 Brussels

Foreword

This amendment was prepared by CENELEC Technical Committee TC 215 "Electrotechnical aspects of telecommunication equipment" under the framework of Mandate M/212 on telecommunication cables and cabling systems.

The text of the draft was submitted to the formal vote and was approved by CENELEC as amendment A1 to EN 50173 on 2000-01-01

The following dates were fixed

- latest date by which the amendment has to be implemented at national level by publication of an identical national standard or by endorsement (dop) 2001-01-01
 - latest date by which the national standards conflicting with the amendment have to be withdrawn (dow) 2002-01-01
-

Foreword of EN 50173

Replace twice "TC 115" by "TC 215" and **replace** "prEN 50098-2" by "EN 50098-2"

Clause 2

Add after EN 50082-1 the following references:

EN 50174-1 Information technology – Cabling installation - Part 1: Specification and quality assurance

EN 50289-1-6 (in preparation) Communication cables - Specifications for test methods - Part 1-6: Electrical test methods - Electromagnetic performance

and

EN 50289-1-9 (in preparation) Communication cables - Specifications for test methods – Part 1-9: Electrical test methods - Longitudinal conversion loss (unbalance attenuation)

Amend reference to EN 55022 to read: „(IEC/CISPR 22:1997)“

Add after EN 55022 the following reference.

EN 55024 Information technology equipment - Immunity characteristics - Limits and methods of measurement (IEC/CISPR 24:1997)

Amend reference to EN 60603-7 to read: „(IEC 60603-7:1996)“

Add after EN 60825-2 the following reference:

EN 61935-1 (in preparation) Generic specification for the testing of balanced generic cabling in accordance with ISO/IEC 11801 – Part 1: Test methods (IEC 61935-1)

Replace HD 323 2 14 by

EN 60068-2-14 Environmental testing - Part 2 Tests - Test N: Change of temperature (IEC 60068-2-14:1984 + A1:1986)“

Replace HD 323.2.38 by

EN 60068-2-38 Environmental testing - Part 2: Tests – Test Z/AD: Composite temperature/humidity cyclic test (IEC 60068-2-38:1974)“

Add "60000" to any IEC number

Subclause 3.2

Add the following abbreviations:

ELFEXT Equal level far-end crosstalk loss

FEXT Far-end crosstalk loss

PSACR Power sum attenuation to crosstalk loss ratio

PSELFEXT Power sum equal level far-end crosstalk loss

PSNEXT Power sum near-end crosstalk loss

Subclause 5.1

Replace the 5th paragraph by:

100 Ω and 120 Ω connecting hardware shall only provide a single direct onward connection for each conductor and shall not provide any electrical contact between conductors. For example bridged taps shall not be used.

Subclause 5.2.1

Replace the existing subclause 5.2.1 by the following text (including figures):

5.2.1 Horizontal distances

The maximum horizontal cable length shall be 90 m independent of medium (see figure 6). This is the cable length from the mechanical termination of the cable in the floor distributor to the telecommunications outlet in the work area.

In establishing the maximum length of the horizontal channel, the optional use of a crossconnect or an interconnect places different requirements on the total length of the flexible cables used

Figure 7 shows examples of horizontal channel implementations which reflect these differing requirements of maximum cable length


In Figure 7a, the maximum total length of work area cable, equipment cable and patch cord is 9 m based upon flexible cables with 50% greater attenuation (dB/m) than the horizontal cable and includes a crossconnect in the floor distributor.

In Figure 7b, the maximum total length of work area cable and equipment cable is 10 m also based upon flexible cables with 50% greater attenuation (dB/m) than the horizontal cable and includes an interconnect in the floor distributor.

In both cases the transition point is optional. It is required that the performance of the horizontal cabling is not degraded by the inclusion of the transition point.

For optical fibre, the implementation is shown in Figure 7c An optical fibre splice, in accordance with clause 8, is allowed at both ends of the horizontal cable.

See clause 8 and Annex C for requirements for patch cords and other flexible cables. In all cases, equipment cables that meet or have better performance characteristics than patch cord requirements are recommended

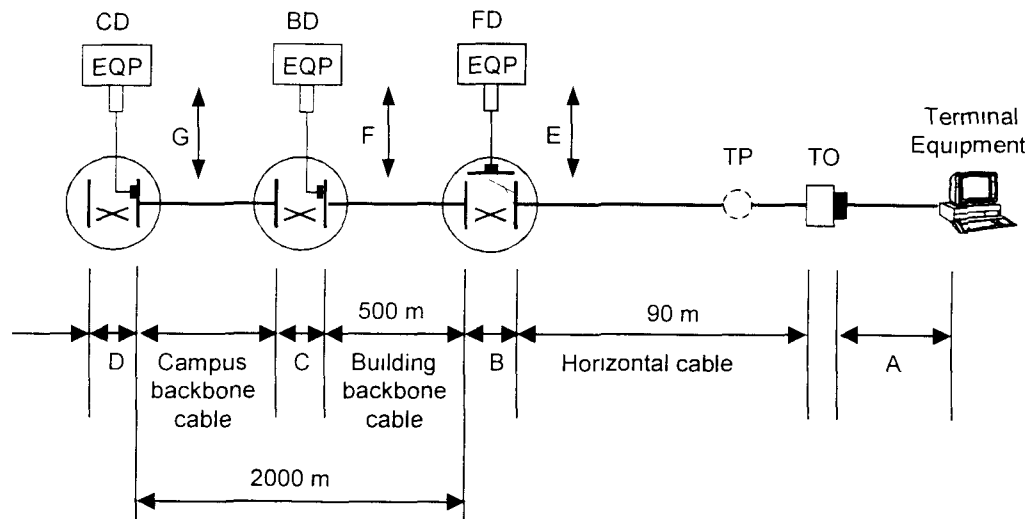

- C, D = 20 m
- F, G = 30 m
- A, B, E see Figure 7
- EQP application specific equipment
- TP Transition Point
- NOTE All lengths are mechanical

Figure 6 - Maximum cable lengths

This is a free preview. Purchase the entire publication at the link below:

[Product Page](#)

-
- [Looking for additional Standards? Visit Intertek Inform Infostore](#)
 - [Learn about LexConnect, All Jurisdictions, Standards referenced in Australian legislation](#)
-